




**Step 5** Select Hose Rack Assembly, Fire Extinguisher and/or Fire Dept. Valve

- Refer to pages 28 & 29 for hose rack assembly details
- Refer to pages 43 to 45 for fire extinguisher details
- Refer to pages 50 to 53 for fire dept. valve details

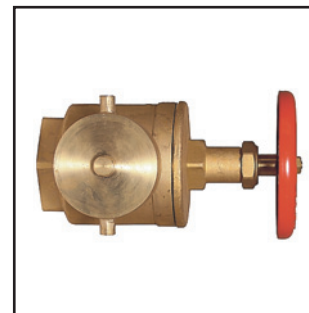

**Additional Information**



**Fire-Rated Cabinets with Fire FX™ Option**

Cabinets fabricated in accordance with the **WARNOCK HERSEY** design\* are certified and listed for use in 1 and 2-hour combustibile and non-combustibile wall systems.

*\* Per UBC standard 43-6 (ASTM-814) under pressure to measure fire resistive performance.*

**Advantages:**

- Maintain wall integrity without having to insulate rough wall opening with fire-rated material
- Eliminate guesswork as to whether fire barrier has been compromised and saves installer considerable time and expense
- Appropriate for either new construction or renovation projects

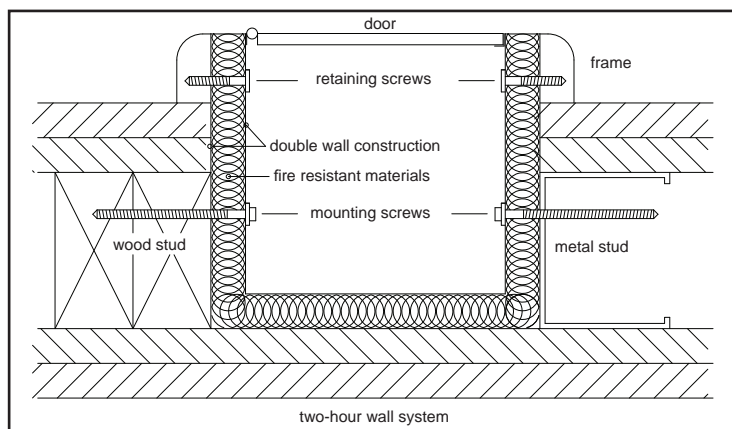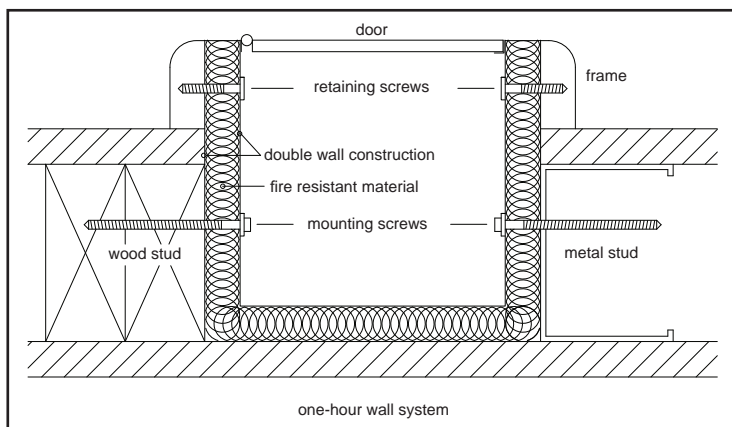

**A.D.A. & Cabinet Compliance**

The Americans with Disabilities Act (A.D.A.) of 1990 mandates that cabinets or other accessories not extend into corridor areas more than 4".

Cabinet models complying with A.D.A. requirements are designated with a check (✓) in the series dimension tables.