
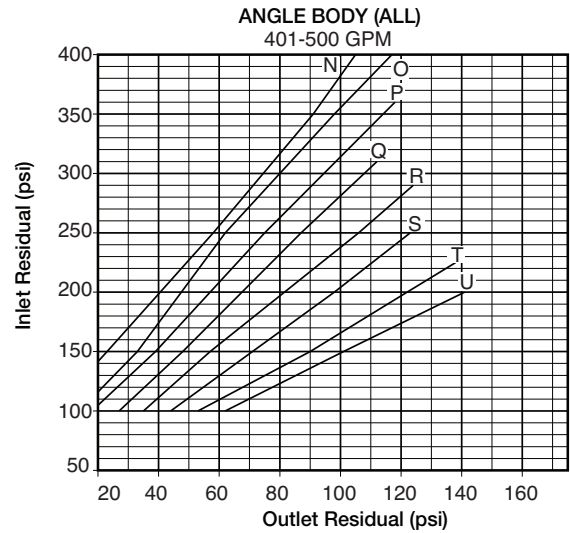
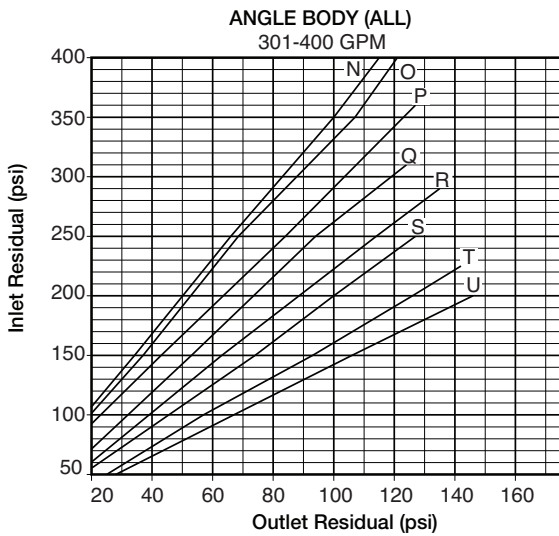
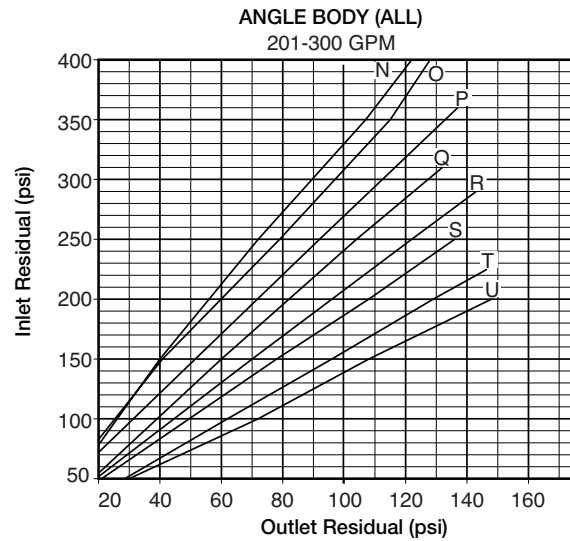


# Residual Pressure Charts

For Pressure-Tru® 2 1/2" Models: ZW4000, ZW4000G, ZW4004 & ZW4004G

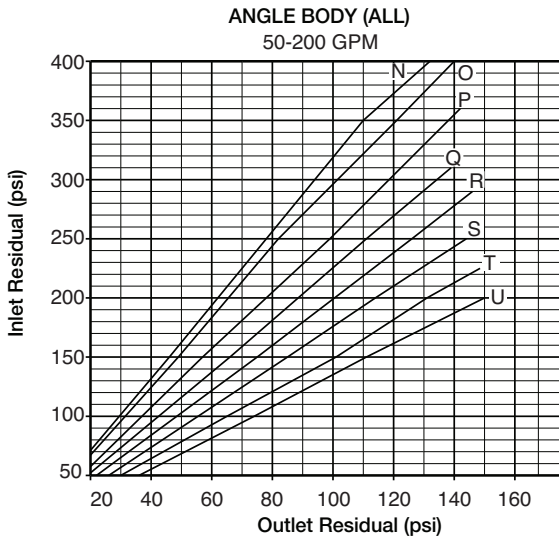

## Choosing The Correct Settings

In designing a sprinkler system, a minimum of 20 psi pressure differential (the difference between the inlet static pressure and the valve outlet set static pressure) is recommended to assure a well regulated and efficient system. In choosing the correct setting for the Pressure-Tru® valve, refer to the Residual Pressure Charts, Static Pressure Chart and the following procedures:

1. Determine the demand in gallons per minute required downstream of the valve.
2. Determine the standpipe residual or "flow pressure" at the valve inlet.
3. Locate the appropriate flow chart based on GPM required and body style.
4. Locate the inlet residual pressure on the vertical axis of the chart and draw a horizontal line from this pressure across the chart.
5. Locate the desired valve outlet residual pressure on the horizontal axis of the chart and draw a vertical line from this pressure.
6. The curve nearest the intersection of the two lines drawn is the appropriate type for the valve.
7. To determine the static outlet pressure, locate the static chart. Determine the valve inlet static pressure shown on the vertical axis and draw a horizontal line from that pressure to the appropriate curve determined above, then draw a vertical line down to the horizontal axis and read the static outlet pressure.

## Maximum Rated Inlet Pressure


Maximum inlet pressure, to assure a maximum outlet pressure of 175 psi. Inlet side of valves can be safely tested up to 400 PSI during system hydrostatic leak test.

Bonnet Type	Max Inlet Pressure psi (kpa)
N	400 (2750)
O	400 (2750)
P	360 (2475)
Q	310 (2125)
R	290 (2000)
S	250 (1725)
T	225 (1550)
U	200 (1375)


# Residual Pressure Charts

For Pressure-Tru® 2 1/2" Models: ZW4000IL & ZW4004IL


INLINE BODY (NPT)  
50-100 GPM

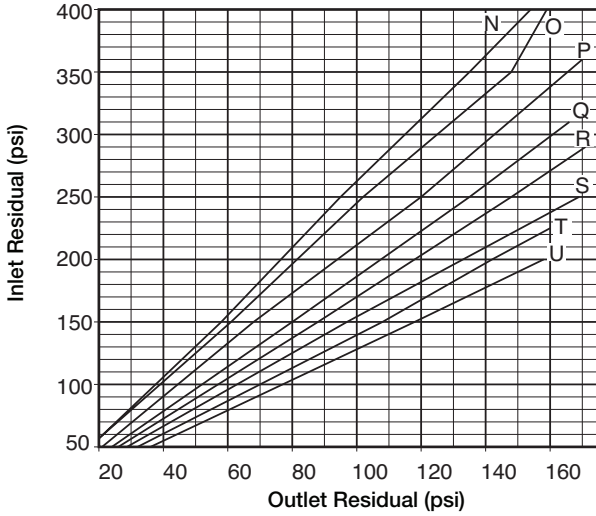


INLINE BODY (NPT)  
101-200 GPM

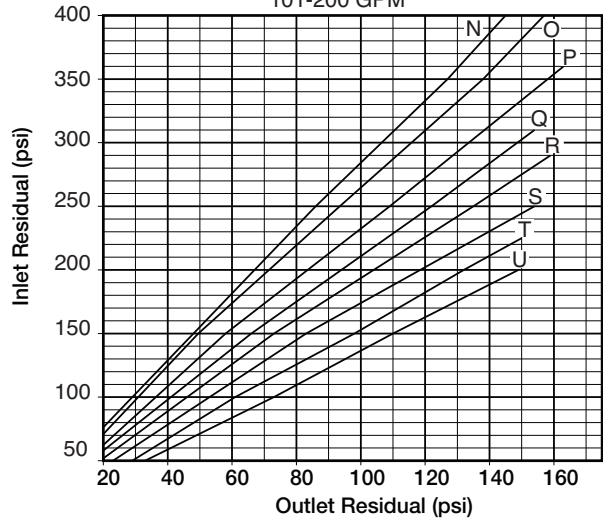


INLINE BODY (NPT)  
201-300 GPM

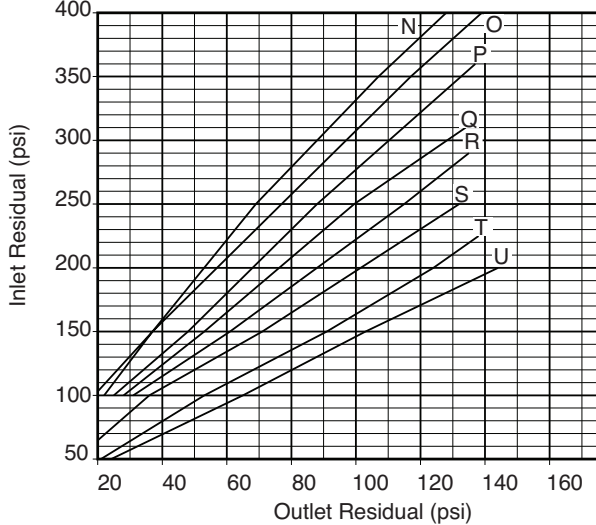


INLINE BODY (NPT)  
301-400 GPM

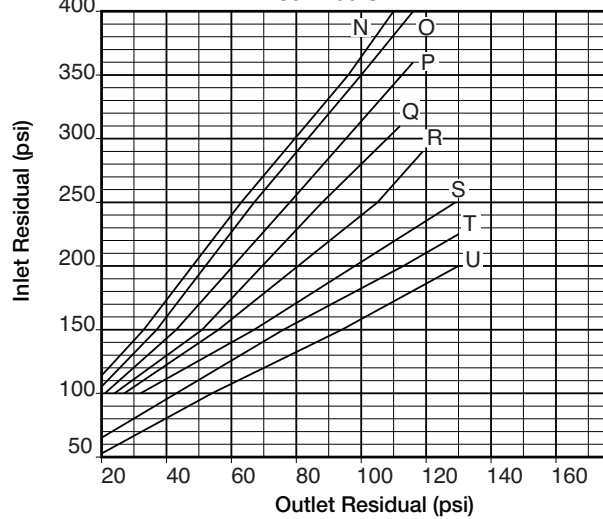

INLINE BODY (NPT)  
401-500 GPM





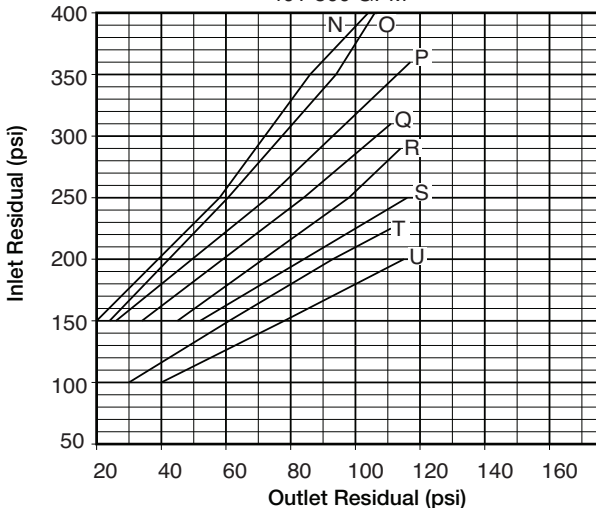


ANGLE & INLINE BODIES (ALL)  
STATIC CHART

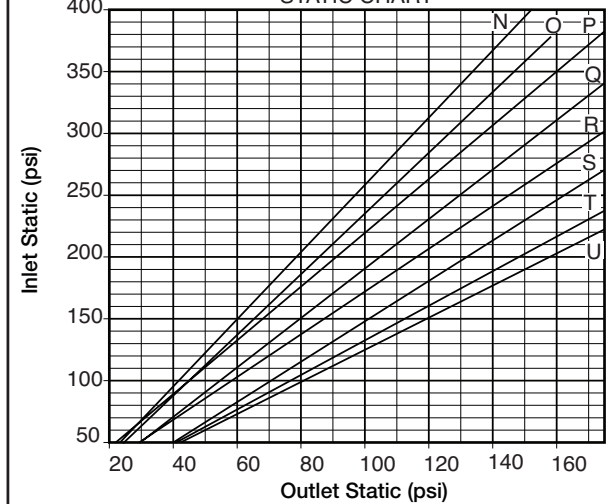

# Residual Pressure Charts



For Pressure-Tru® 2 1/2" Models: ZW4000ILG & ZW4004ILG

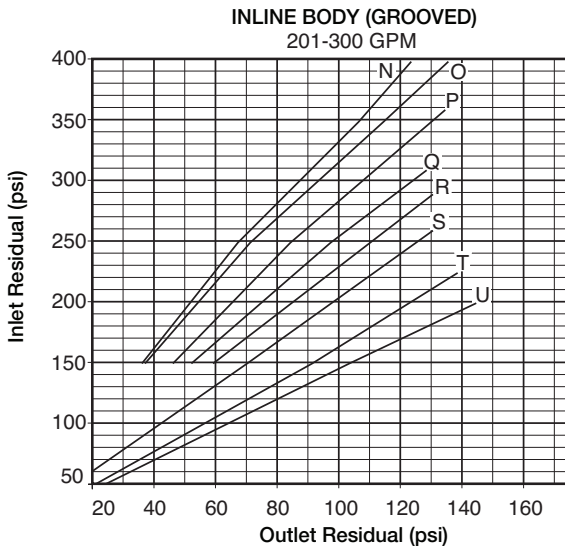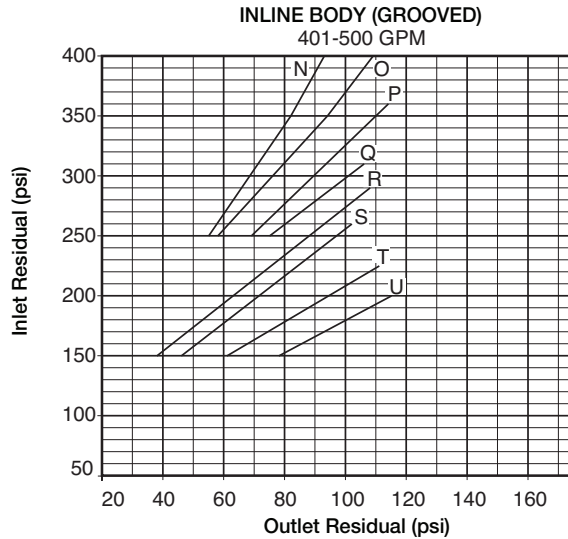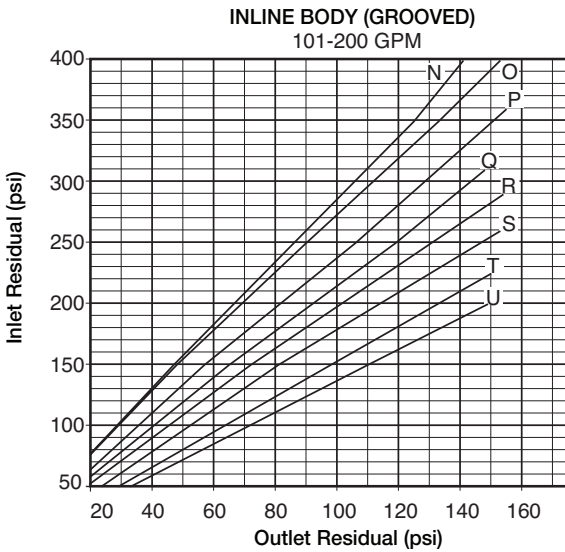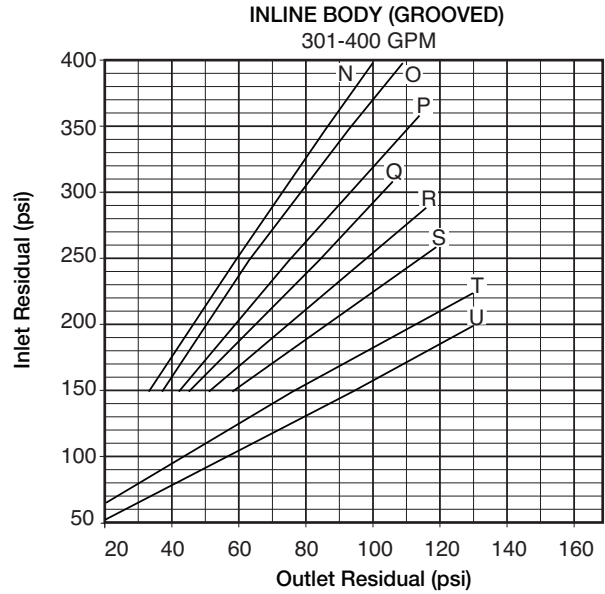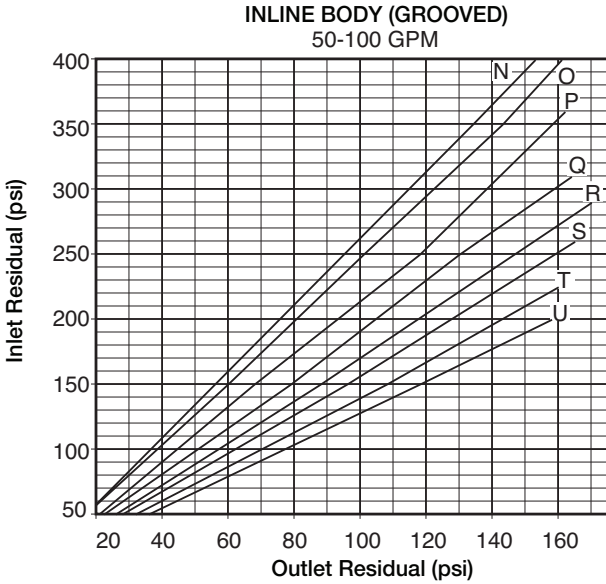

Proper performance is dependent upon licensed, qualified personnel performing regular, periodic testing according to ZURN WILKINS' specifications and prevailing governmental & industry standards and codes and upon following these installation instructions. Failure to do so releases ZURN WILKINS of any liability that it might otherwise have with respect to that device. Such failure could also result in an improperly functioning device.

# Residual Pressure Charts

For Pressure-Tru® 1 1/2" Models: ZW4100, ZW4100G, ZW4104 & ZW4104G

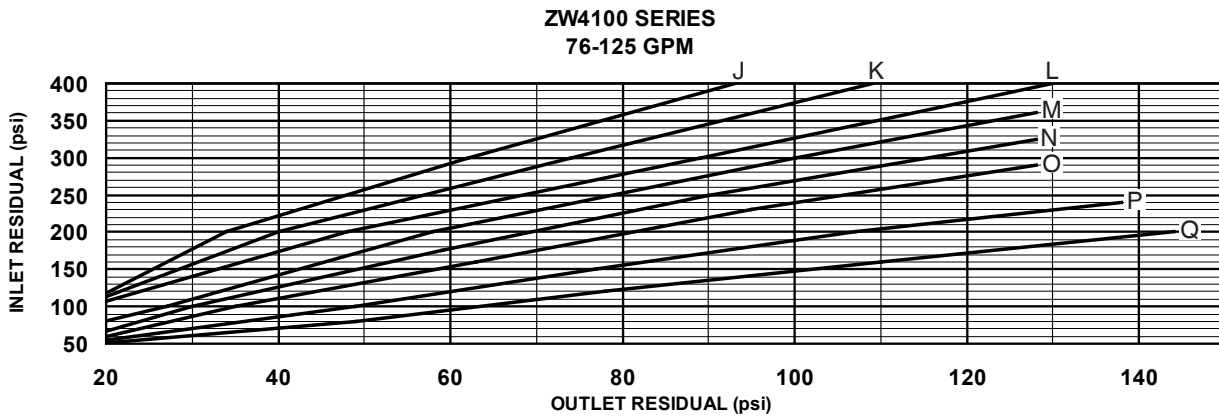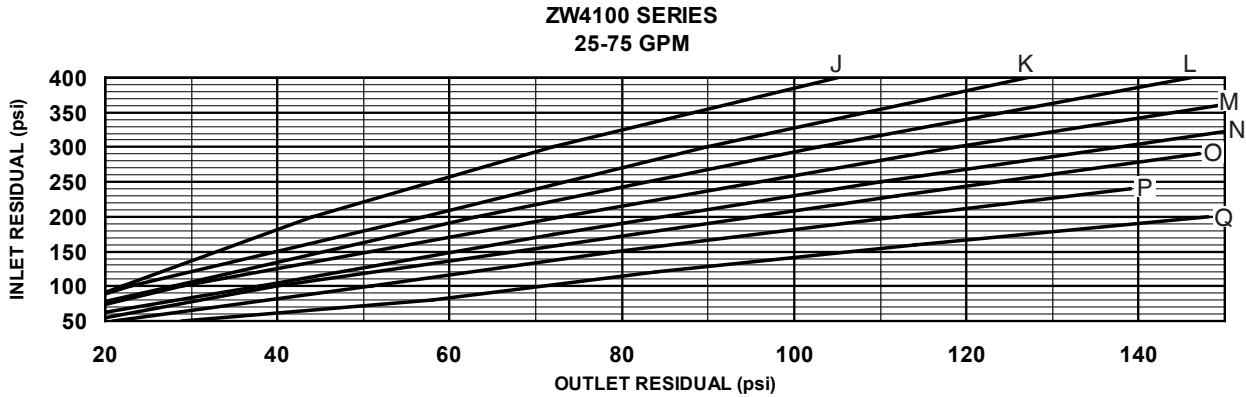

## Choosing The Correct Settings

In designing a sprinkler system, a minimum of 20 psi pressure differential (the difference between the inlet static pressure and the valve outlet set static pressure) is recommended to assure a well regulated and efficient system. In choosing the correct setting for the Pressure-Tru® valve, refer to the Residual Pressure Charts, Static Pressure Chart and the following procedures:

1. Determine the demand in gallons per minute required downstream of the valve.
2. Determine the standpipe residual or "flow pressure" at the valve inlet.
3. Locate the appropriate flow chart based on GPM required and body style.
4. Locate the inlet residual pressure on the vertical axis of the chart and draw a horizontal line from this pressure across the chart.
5. Locate the desired valve outlet residual pressure on the horizontal axis of the chart and draw a vertical line from this pressure.
6. The curve nearest the intersection of the two lines drawn is the appropriate type for the valve.
7. To determine the static outlet pressure, locate the static chart. Determine the valve inlet static pressure shown on the vertical axis and draw a horizontal line from that pressure to the appropriate curve determined above, then draw a vertical line down to the horizontal axis and read the static outlet pressure.

## Maximum Rated Inlet Pressure

Maximum inlet pressure, to assure a maximum outlet pressure of 175 psi. Inlet side of valves can be safely tested up to 400 PSI during system hydrostatic leak test.


Bonnet Type	Max Inlet Pressure psi (kpa)	
J	400	(2750)
K	400	(2750)
L	400	(2750)
M	360	(2475)
N	325	(2240)
O	290	(2000)
P	240	(1650)
Q	200	(1375)

Proper performance is dependent upon licensed, qualified personnel performing regular, periodic testing according to ZURN WILKINS' specifications and prevailing governmental & industry standards and codes and upon following these installation instructions. Failure to do so releases ZURN WILKINS of any liability that it might otherwise have with respect to that device. Such failure could also result in an improperly functioning device.


# Residual Pressure Charts

For Pressure-Tru® 1 1/2" Models: ZW4100, ZW4100G, ZW4104 & ZW4104G


**ZW4100 SERIES**  
126-150 GPM

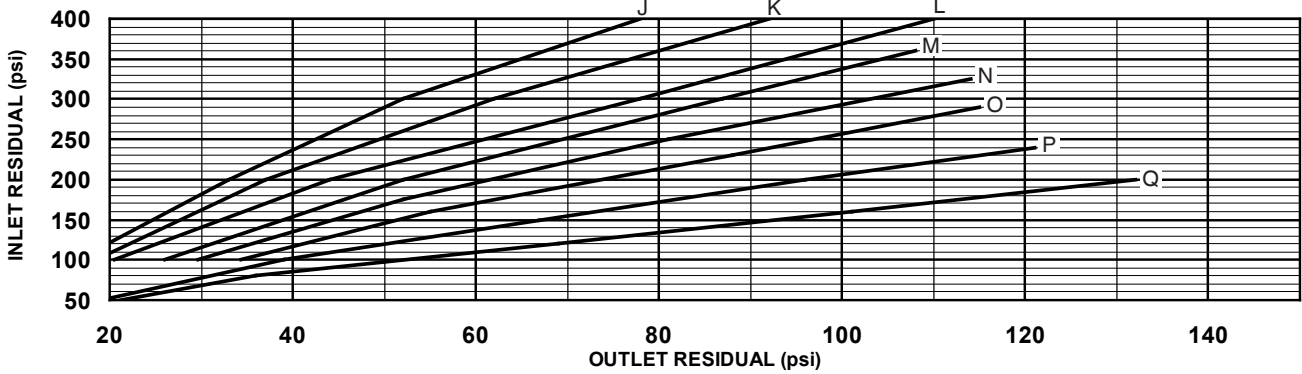

**ZW4100 SERIES**  
151-175 GPM

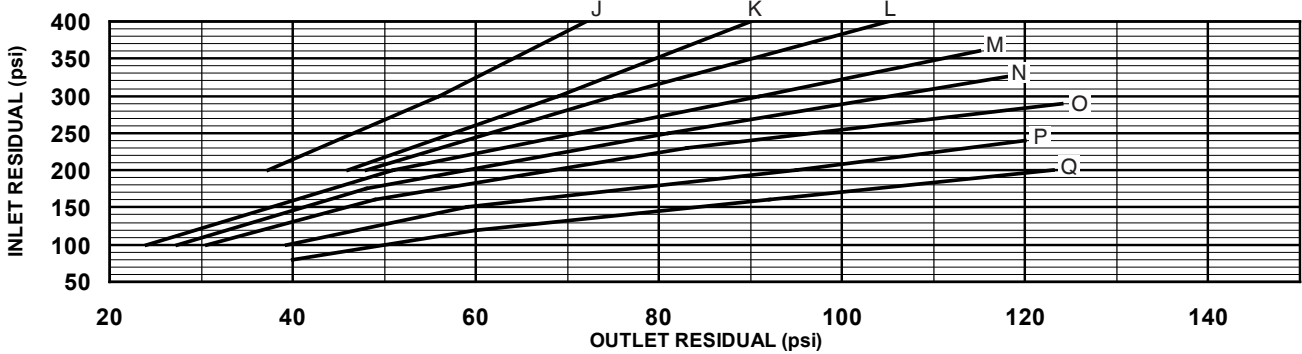

**ZW4100 SERIES**  
176-200 GPM

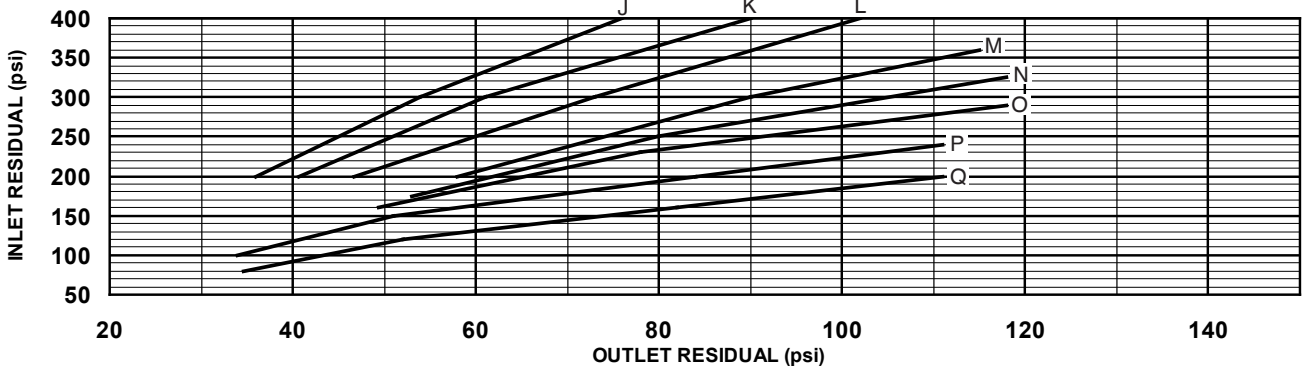

**ZW4100 STATIC CHART**

